

Number	22-003221-PR01 (NW T02-A01-04-en-01)
Owner	Smaj produkt d.o.o. Lazarevo selo bb 18110 Nis Serbia
Product	Single window, single leaf
Designation	Shipping name: ALD SMAJ
Details	Manufacturer Smaj produkt d.o.o., - Nis; Type of opening Tilt-turn window; Overall dimensions (W x H) 1230 mm x 1480 mm; Rebate seal levels 3; Mass, area-related 49.8 kg/m ² ; IGU: Glass configuration 8 LSG (acoustic foil) / 20 cavity (Ar) / 4 float / 18 cavity (Ar) / 8 LSG (acoustic foil); Frame member: Material Wood-aluminium; Projected width 91 mm; Structural depth 81 mm; Casement member: Material Wood-aluminium; Projected width 70 mm; Structural depth 99 mm
Special features	
Result	

Weighted Sound Reduction Index R_w and Spectrum-Adaptation Terms C and C_{tr} according to EN ISO 10140-2: 2021-05, EN ISO 717-1: 2020-12




$$R_w (C; C_{tr}) = 42 (-1; -2) \text{ dB}$$

Basis *)

EN ISO 717-1: 2020-12
EN ISO 10140-1: 2021-05
EN ISO 10140-2: 2021-05
*) and corresponding national versions (e.g. DIN EN)

Test report: 22-003221-PR01 PB
T02-A01-04-de-01

Representation

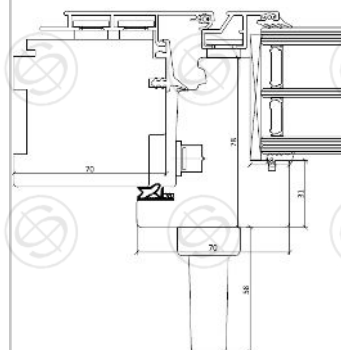

Instructions for use

The results obtained can be used as evidence in accordance with the above basis.

Validity

There is no time limit.
When using this document the up-to-dateness of above basis and the conformity of the product have to be observed.

Notes on publication

The ift-Guidance Sheet "Conditions and Guidance for the Use of ift Test Documents" applies.

ift Rosenheim

27.07.2023



Dr. Joachim Hessinger, Dipl.-Phys.
Head of Testing Department
Building Acoustics



Johann Baume, Dipl.-Ing. (FH)
Operating Testing Officer
Building Acoustics

Identity-Check



www.ift-rosenheim.de/ift-geprueft
ID: ED2-442AE