

Number	22-003221-PR01 (NW T03-A01-04-en-01)
Owner	Smaj produkt d.o.o. Lazarevo selo bb 18110 Nis Serbia
Product	Single window, single leaf
Designation	Shipping name: IV68
Details	Manufacturer Smaj produkt d.o.o., - Nis ; Type of opening Tilt-turn window ; Overall dimensions (W x H) 1230 mm x 1480 mm ; Rebate seal levels 2 ; Mass, area-related 35.7 kg/m² ; IGU: Glass configuration 8 LSG (PVB foil) / 16 cavity (Ar) / 6 LSG (PVB foil) ; Frame member : Material Wood ; Projected width 81 mm ; Structural depth 68 mm ; Casement member : Material Wood ; Projected width 76 mm ; Structural depth 68 mm
Special features	
Result	

Weighted Sound Reduction Index R_w and Spectrum-Adaptation Terms C and C_{tr} according to EN ISO 10140-2: 2021-05, EN ISO 717-1: 2020-12




$$R_w (C; C_{tr}) = 42 (-1; -4) \text{ dB}$$

Basis *)

EN ISO 717-1: 2020-12
EN ISO 10140-1: 2021-05
EN ISO 10140-2: 2021-05
) and corresponding national versions (e.g. DIN EN)
Test report: 22-003221-PR01 PB T03-A01-04-de-01

Representation

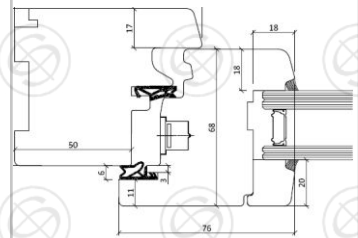

Instructions for use

The results obtained can be used as evidence in accordance with the above basis.

Validity

There is no time limit.
When using this document the up-to-dateness of above basis and the conformity of the product have to be observed.

Notes on publication

The ift-Guidance Sheet "Conditions and Guidance for the Use of ift Test Documents" applies.

ift Rosenheim
27.07.2023



Dr. Joachim Hessinger, Dipl.-Phys.
Head of Testing Department
Building Acoustics



Johann Baume, Dipl.-Ing. (FH)
Operating Testing Officer
Building Acoustics

Identity-Check



www.ift-rosenheim.de/ift-geprueft
ID: 62D-58B4A